


INDICATIVE SECTION THROUGH HV CABLE DUCTS UNDER EXISTING BOUND ROADS / TRACKS  
Scale: 1:25

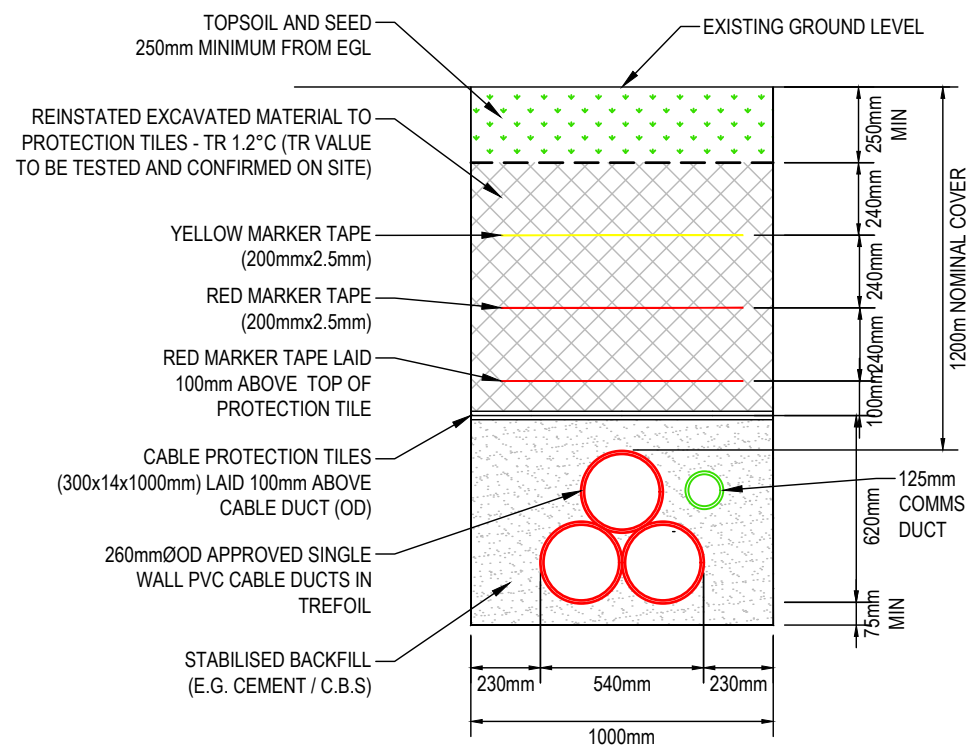


INDICATIVE SECTION THROUGH HV CABLE DUCTS UNDER SOFT GROUND  
Scale: 1:25

NOTES

1. FOR INDICATIVE CABLE CORRIDOR CROSS SECTIONS REFER TO DRAWING LF000010-DEV-PLN-169.
2. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE NOTED.
3. ALL DIMENSIONS ARE INDICATIVE.
4. DETAILS RELATING TO SERVICES CROSSINGS TO BE PROVIDED FOLLOWING FUTURE DESIGN.
5. CABLE ARRANGEMENT MAY BE TREFOIL OR FLAT FORMATION.

PLANNING DRAWING

Scale 1:25



Rev	Date	Status	Drwn	Chkd	Appd
02	08/03/23	ISSUED FOR PLANNING.		DL	BG/JD CM
01	23/02/23	ISSUED FOR PLANNING.		DL	BG/JD CM



Project **BERWICK BANK WIND FARM**

Title **INDICATIVE OPEN CUT TRENCH SECTION**

Status **ISSUED FOR PLANNING**

Scale **AS SHOWN**

SSE Drawing number **LF000010-DEV-PLN-170**

Sheet No. **001 OF 001**

Revision **02**